

CERTIFICATE OF APPROPRIATENESS APPLICATION FORM

Incomplete applications will not be processed for Commission review.
Please print legibly.

1. **HISTORIC NAME OF PROPERTY OR HISTORIC DISTRICT:** (if known)

Historic Hummel-Uihlein Building

ADDRESS OF PROPERTY:

2673 North Martin Luther King Drive

2. **NAME AND ADDRESS OF OWNER:**

Name(s): City of Milwaukee

Address: 809 North Broadway

City: Milwaukee

State: WI

ZIP: 53202

Email: ylapie@milwaukee.gov

Telephone number (area code & number) Daytime: X-5762

Evening: _____

3. **APPLICANT, AGENT OR CONTRACTOR:** (if different from owner)

Name(s): Yves LaPierre, DCD, Real Estate

Address: _____

City: _____

State: _____

ZIP Code: _____

Email: _____

Telephone number (area code & number) Daytime: _____

Evening: _____

4. **ATTACHMENTS:** (Because projects can vary in size and scope, please call the HPC Office at 414-286-5712 for submittal requirements)

A. REQUIRED FOR MAJOR PROJECTS:

- ☒ Photographs of affected areas & all sides of the building (annotated photos recommended)
- ☒ Sketches and Elevation Drawings (1 full size and 1 reduced to 11" x 17" or 8 1/2" x 11")
A digital copy of the photos and drawings is also requested.
- ☒ Material and Design Specifications (see next page)

B. NEW CONSTRUCTION ALSO REQUIRES:

- _____ Floor Plans (1 full size and 1 reduced to a maximum of 11" x 17")
- _____ Site Plan showing location of project and adjoining structures and fences

PLEASE NOTE: ***YOUR APPLICATION CANNOT BE PROCESSED UNLESS
BOTH PAGES OF THIS FORM ARE PROPERLY COMPLETED
AND SIGNED.***

5. **DESCRIPTION OF PROJECT:**

Tell us what you want to do. Describe all proposed work including materials, design, and dimensions. Additional pages may be attached.

Repair of roof and gutters to create watertight condition and help preserve building.

6. **SIGNATURE OF APPLICANT:**

Signature

Yves LaPierre

Please print or type name

February 4, 2016

Date

This form and all supporting documentation **MUST** arrive by 12:00 noon on the deadline date established to be considered at the next Historic Preservation Commission Meeting. Any information not provided to staff in advance of the meeting will not be considered by the Commission during their deliberation. Please call if you have any questions and staff will assist you.

Hand Deliver or Mail Form to:
Historic Preservation Commission
City Clerk's Office
200 E. Wells St. Room B-4
Milwaukee, WI 53202

PHONE: (414) 286-5722

FAX: (414) 286-3004

www.milwaukee.gov/hpc

Or click the **SUBMIT** button to automatically email this form for submission.

SUBMIT

Scope of Work for 2673 North Martin Luther King Drive

2673 North Martin Luther King Drive is the Historic Hummel/Uihlein Building.

Property requires renovations to return it to its original, historic condition.

Contractor must be skilled and experienced in renovating older, distressed properties. Renovations require like-with-like materials that match patterns and dimensions on the existing house. Contractor is responsible for verification of all field measurements and material quantities.

Items that need renovation are listed below followed by general specs for repair items. Note that this list is to be used in conjunction with the technical specifications that are part of the bid package. Contractor must read and follow all technical specifications – (for example - comply with the lead safe rehab standards as outlined in Section 01810 LeadDust Hazards, etc...)

Bids to include all labor and materials. Change orders will not be approved for routine repairs that are part of exterior renovations and should be included in the base bid. Change orders will be considered for extraordinary circumstances that arise during renovation work and that cannot be determined through initial inspections.

2673 North Martin Luther King Drive

1. Building requires roof and gutters to insure building is weather tight. All sheet metal decorative elements to be preserved and care taken to not damage them.
2. Main roofs requires a complete tear off, replace any rotten boards and roof rafters, decking/sheathing and installation of appropriate rubber membrane roofing. Care to be taken to properly affix membrane up the existing parapet walls.
 - o Remove old skylight and any trap doors on roof, reframe roof joists and sheath these locations and reroof.
3. Install appropriate high-capacity gutters and downspout at rear of roof slope for south addition of building. Existing gutter and downspout on original north building can be maintained.
 - o Rebuild brick on south addition where existing gutter scupper is located. Rebuild brick to minimal degree to allow roofing and gutter attachment.
 - o Remove existing chimney at rear of addition, located at gutter line. Roof over old chimney location.

General Specifications for Roofing and Gutters

Roofing shingles to be used are GAF Timberline, Natural Shadow in Pewter Gray or Barkwood color, unless otherwise specified. Drip edges, gutter apron and roof valleys should match color of roof shingles as closely as possible (e.g. use black drip edge etc... when installing pewter gray shingles.)

- 1) Tear off all roofing material down to the original boards.
- 2) Inspect and replace rotted, damaged or missing boards using like-with-like dimensioned boards.
- 3) Sheath the roof with OSB a minimum of 7/16" thick to create a continuous nailing surface.
- 4) To avoid interior water damage only tear off as much roof area as can be repaired and sheathed in the same day. No roof shall be left with open areas overnight. Any roof that has not had felt applied shall be securely tarped at the end of the work day.
- 5) Install 15 lb. (non-perforated) felt with 3" minimum overlap using T-50 3/8" staples.
- 6) Install 3 ft. wide "Ice and Water Shield" along all eave lines. On eaves extending out more than 3 feet add a second row of "Ice and Water Shield" with a 6" overlap.
- 8) For all roof venting cut a 3" wide channel along the gable peak to within 2 feet of the roof edge for installation of a ridge vent. (NOTE: Pan vents are NOT permitted unless approved by owner's representative.)
- 9) Install manufactured **Black** aluminum 1-1/4" drip edge along entire gable roof edge, and **Black** gutter apron with 1/4" shingle overlap at eave edge. Install using 1-1/4" galvanized roofing nails.
- 10) Install a full shingle starter strip along the base of the roof. The architectural shingles are to be nailed down using roofing nails. The size of the nail is determined by the thickness of the roofing material (typically 1-1/4"). Nail the shingles just below the tar strip using 4 nails per shingle, or in the thickest area of the shingle follow manufactures specifications.
 - a) Install the first architectural shingle 1/4 inch over the edge of the roof to force any water away from the fascia. It will also help prevent any fascia deterioration.

Gutters

Install new half-round gutters and downspouts. Gutter and downspout color to be **granite gray** unless otherwise specified. Gutters to be half-round unless otherwise specified.

a) Half-round gutters must be installed with brackets or straps installed under the roof shingles and not directly mounted to the fascia board. All gutters shall be a minimum of .032 gauge, maintain a minimum slope of 1/2" per 10 running feet of gutter, and shall be attached approximately every 32" on center, or every other rafter tail, and shall be a minimum of 1/2" from the fascia board.

b) Gutters longer than 40 feet should be sloped in two directions from the midpoint of the gutter and connected to a minimum of a 4" diameter downspout. All downspouts shall be a minimum of 024 gauge.

Go to this link to find out more about 1/2 round gutters vs. K style including price, <http://www.guttersupply.com/p-halfround.gstml>

Aluminum half round gutters are supplied by the gutter store in various colors. www.merchantcircle.com/business/The.Gutter.Store.414-258-8000

Chimneys and flashing

- If the chimney exits the roof below the ridge, a chimney saddle must be installed where none exist.
- All chimneys shall be flashed with permanent metal base flashing and counter flashing. Step flashing to be installed when specified.
- Install appropriate flashing at any wall and roof intersections.

Decorative tin ornamentation and metal flashing

- To be repaired per specifications provided by owner's representative

- a) Porch hand rails will include a bread loaf upper rail and a bottom rail built up with 2X and 1X material (see plans). Bottom rail to be installed 3" inches above the porch deck.
 - b) Railings will be attached to newel posts, columns, or the house with 4" galvanized counter-sunk screws to allow future repair and replacement.
 - c) Railings will have 2" x 2" (actual 1-1/2" x 1-1/2") square stock spindles spaced 1-1/4" apart, and all spindles will be installed in a minimum 1/4" x 1-1/2" blank with galvanized 1-1/2" screws.
 - d) Stair rails will mirror the design of the hand railings and be attached to newel posts.
 - e) Upper porch railings on second floor porches will mirror the design and appearance of the first floor railing, except that newel posts may be designed proportionately narrower.
5. When repairing or rebuilding porch skirts all materials will be of like-with-like wood replacement of the same design and dimensions as originally existed or as specified by the drawings provided by the Owner's Representative.
- a) All porch skirts will be installed with a continuous board frame that is a minimum of 6" in width. Clear cedar boards must be used where wood meets the ground in areas such as porch skirt board frames and stairs.
 - b) All framing will cover the rough framing lumber of the support posts, columns and beams.
 - c) All skirts will incorporate a slat design that will closely mirror the design of the wood railings above or as specified by the Owner's Representative.
6. When repairing or rebuilding stairs all components will be of like-with-like clear wood materials (no knots, no sapwood).
- a) All stairs will be supported by a minimum of three stringers with steps of equal height, and no step will exceed 8 inches in height.
 - b) There will be no more than a 3/16" variation between steps.
 - c) Each step will have a minimum tread width of 11" with a tread overhang of no more than 1 inch.

GENERAL SPECIFICATIONS for MASONRY

All brick and mortar repairs must blend with existing brick and mortar color, patterns, mortar mix and joint thickness. Repairs must maintain the historic integrity of existing brick and masonry work. These guidelines to be followed where applicable.

- 1) When doing mortar or brick repair, or replacement on historic homes the following process/procedure is to be followed:
- 2) Inspect all masonry for signs of deterioration. Identify any bricks that are cracked or spalled, and determine the reason for the damage. Replace damaged bricks using like-with-like material.
- 3) Check for cracks in the mortar joints and determine if excessive settling has occurred which will require additional foundation repairs.
- 4) When repairing foundations be sure to incorporate the same brick pattern. The contractor shall use like-with-like dimensioned bricks of similar color and density for any repairs.
- 5) When removing any damaged brick from a chimney, or rebuilding a chimney it is critical that the contractor take photos of the existing chimney, so that they can duplicate the corbelling pattern that exists. Rebuilt chimneys MUST be completed using the same type, pattern and dimensions as the existing chimney. When in doubt the chimney design on page 97 of "As Good As New" may be used if approved by the Owner's Representative.
- 6) When tuckpointing brick or block the old mortar must be removed to a minimum depth of 3/4" by means of a tuckpointer's rake pulled across the joint or lightly tapping with a hammer. If the mortar does not come loose a hammer and plugging chisel should be used. Either of these methods is preferred. Use of an electric grinder should only be done in areas that are not visible to the general public such as rear walls, and then only after being approved by the Owner's Representative. Great care must be taken not to damage the brick. "No mortar removal is to be done using a reciprocating saw with a masonry blade."
- 7) When applying the new mortar to **Cream City brick** the joint should be damp but not dripping wet. The new mortar should use a lime mortar mix with one part lime to two parts sand. Use Type "K" mortar if available and Type "O" mortar as a second option. Cream city brick to be cleaned with Diedrich's 606 and 101 products according to manufacturer's directions.
- 8) When tuckpointing it is important that the mortar match the existing mortar in color. New mortar must be colored or tinted and installed in an inconspicuous test area, prior to installing it in highly visible areas.

2673 North Martin Luther King Drive. Historic Hummel / Uihlein Building




North Elevation
Chimneys

Front Façade Hip Roof

South Addition

Original Building

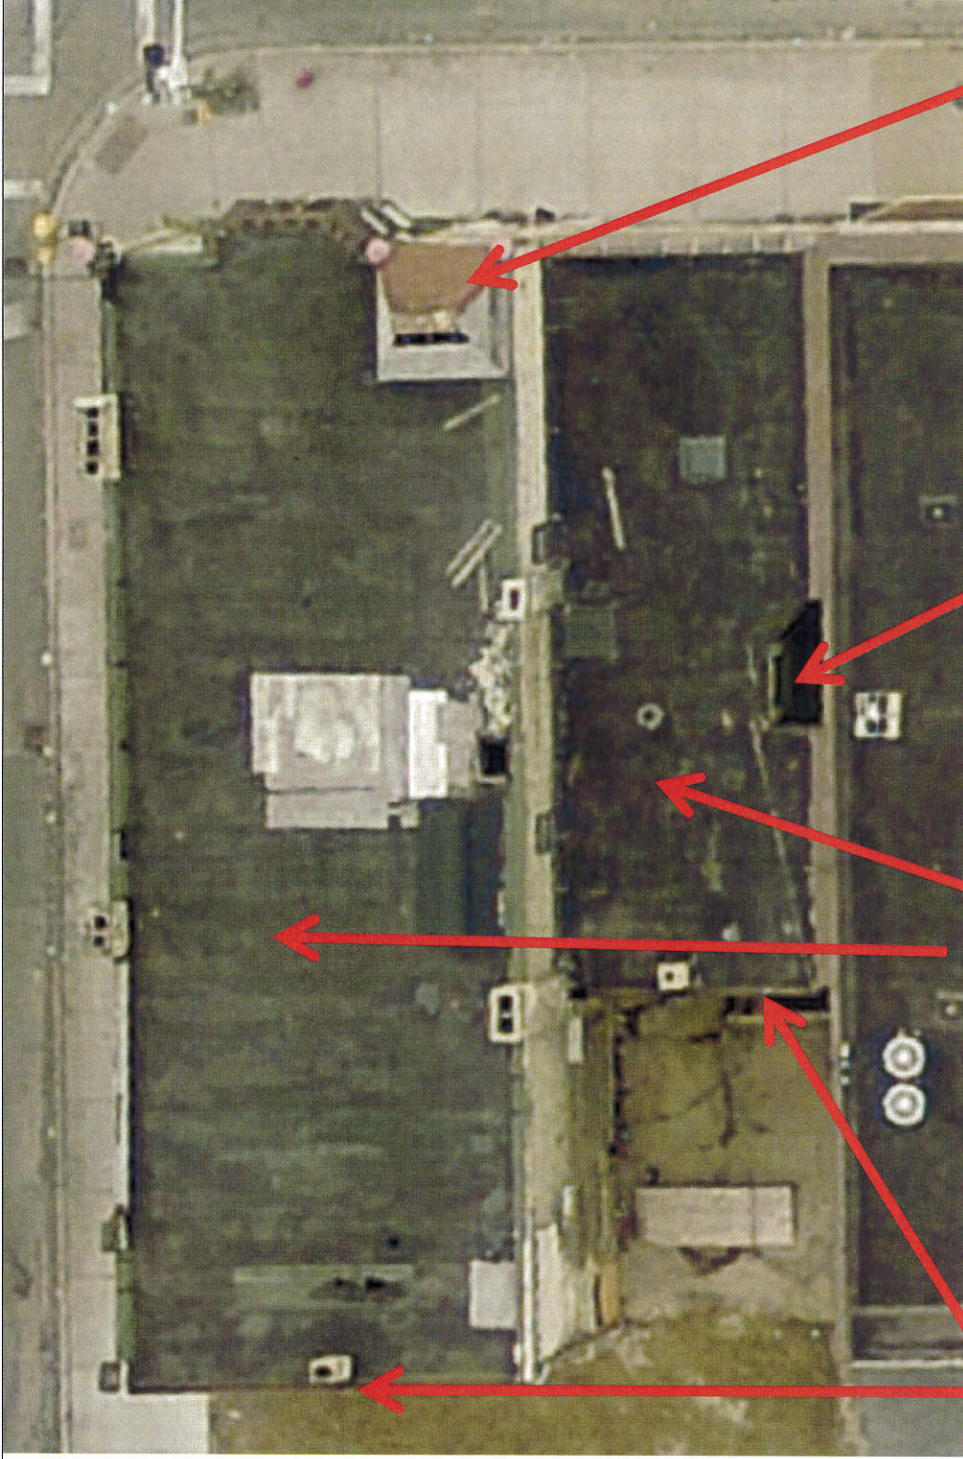


Front Façade Hip Roof

Light Well

Main Roofs

Gutters


2673 North Martin Luther King Drive. Historic Hummel / Uihlein Building

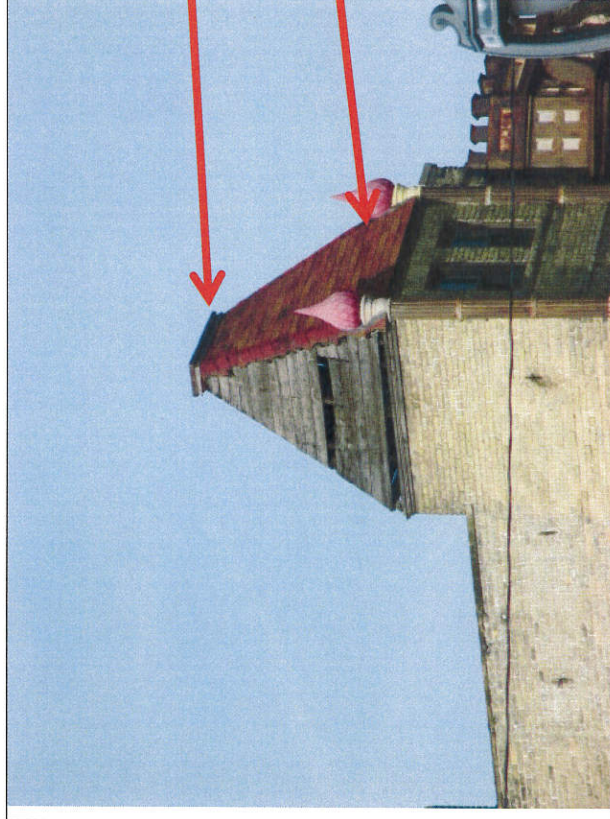

Repair and reroof hip roof at front façade

Repair base wood trim and wood crown

Protect and preserve all existing decorative sheet metal ornaments

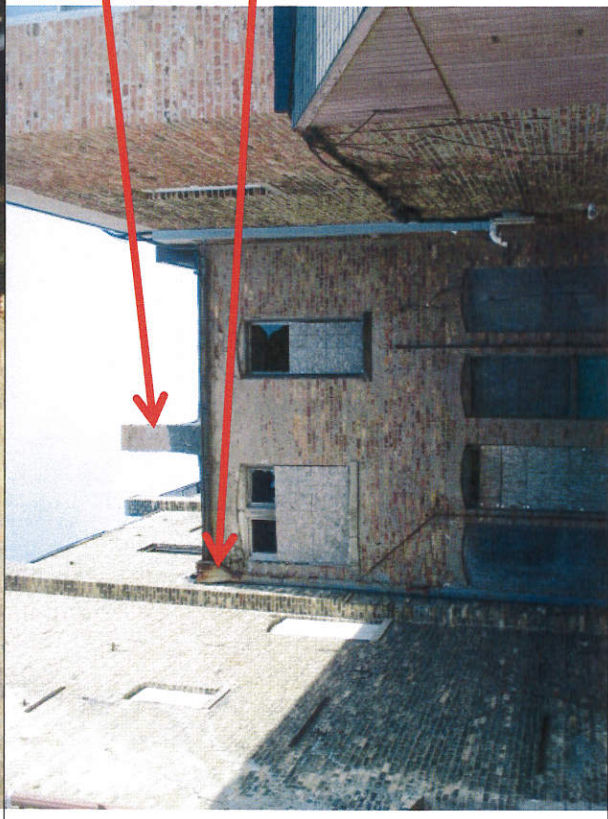

Remove chimney

Repair and rebuild failing brick corner


New gutter and downspout

2673 North Martin Luther King Drive. Historic Hummel / Uihlein Building



Alternate Bid item #1:

Rebuild two existing chimneys at top north elevation of building

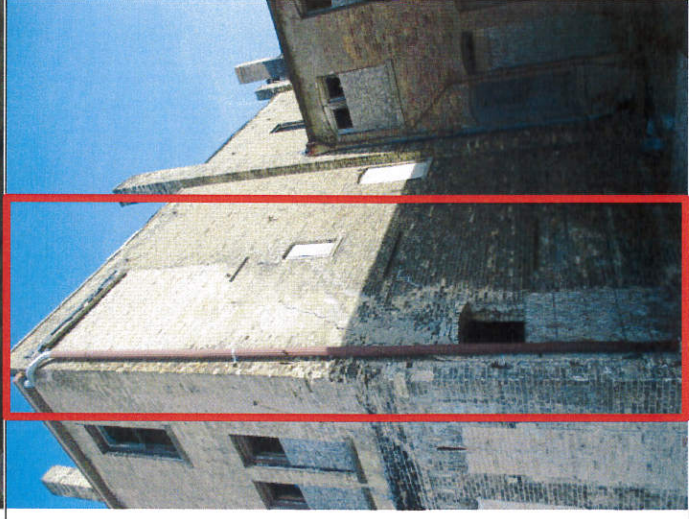

Alternate Bid item #2:

Rebuild rear south section of wall that is failing and has a large step-crack. Existing cream city brick to be recycled or matching bricks to be used for any replacements. Existing doorway to be bricked up.